

# Automatic Capacitor Controls



**Innovative · Reliable · Versatile · Simple**

# Control For All Seasons

The MCap II and eCAP II series of capacitor controls are a powerful yet affordable choice for controlling single step switched capacitor banks.

The MCap II automatically opens or closes the capacitor switch in response to system changes. The eCAP II provides the same functionality plus remote control of the capacitor bank and remote access to system data.

The MCap II and eCAP II can be programmed to switch based on changes in:

- Voltage
- Temperature
- Amps
- Watts
- Vars
- Time
- Power Factor
- Day of week



*The standard eCAP II control provides remote, local and automatic control in a simple package.*



*The Standard MCap II (QCM1) control provides local and automatic control in a simple package.*

The MCap II and eCAP II are available as a Standard model or an Extended model, which adds a 2-line LCD display and toggle switches that can be used to program the control in the field without a computer. All models include a USB port for interfacing with a PC, data retrieval and viewing system information.

All controls can be furnished with either full or limited feature set. The Limited version supports time, temperature and voltage switching strategies while the Full Feature version supports all switching parameters.

The control firmware is flash upgradeable via the front panel USB port, so as improvements and bug fixes are released, the control can be easily upgraded to incorporate all the latest feature sets.

All MCap II and eCAP II controls include support for a line post current sensor regardless of the feature set chosen by the user.

**Your First Choice**

**..... The Smart Choice**

# ...And All Strategies

The eCAP II has the same functions as the MCap II plus supports remote communications with SCADA. Communications equipment is mounted inside the enclosure to protect the communications device and simplify antenna connections. All analog, status and control points are remotely accessible via DNP3, Modbus, REMS 102, or QUICS communications protocol as standard. IEC60870-5-101/104 is optionally available.

The eCAP II is also available in a Limited version (Time, Temperature and Voltage functions only.)



*The Extended eCAP II (QCE2) controller provides remote and local control in a package complete with LCD display and front panel configuration switches*

### Control features include:

- Choice of mounting schemes; 4 or 6 jaw meter base or direct pole mounting
- Support for all line post current sensors
- Compatibility with all oil and vacuum, motor or solenoid operated switches
- Neutral current or voltage trip or close support
- All control fuses located on front panel

- Hardware and software can be upgraded to add functionality as needs evolve
- Test jacks for measuring voltage and current
- SuperCap instead of battery, to maintain the internal clock and historical data; provides greater reliability and lower cost of ownership both in material and maintenance time/labor.



*The Extended MCap II (QCM2) control provides local and automatic control in a package complete with LCD display and front panel configuration switches.*

### eCAP II also includes:


- DNP 3.0 level 2 compliant
- Unsolicited reporting and user selectable point list
- Support for all communications media (radio, cellular, etc.)
- SCADA override and inhibit to coordinate local and remote control functions
- Hinged faceplate protects communications device from elements when controlled door is open

# SmartWare II™

SmartWare II allows a user to create or modify a switching strategy and send it to a control, read the current configuration, save or load a configuration to or from a file, monitor real-time control operation, and retrieve historical data.

The graphical user interface (GUI) is streamlined and follows a logical progression through each of the available menu options. Tool tips and message boxes guide the user through the controller setup, and the program performs extensive error checking (min, max, non-numerical values) on and between displays.

SmartWare II supports up to four seasons with up to three-time periods per season. Each season or time period can use the same or different switching strategy.

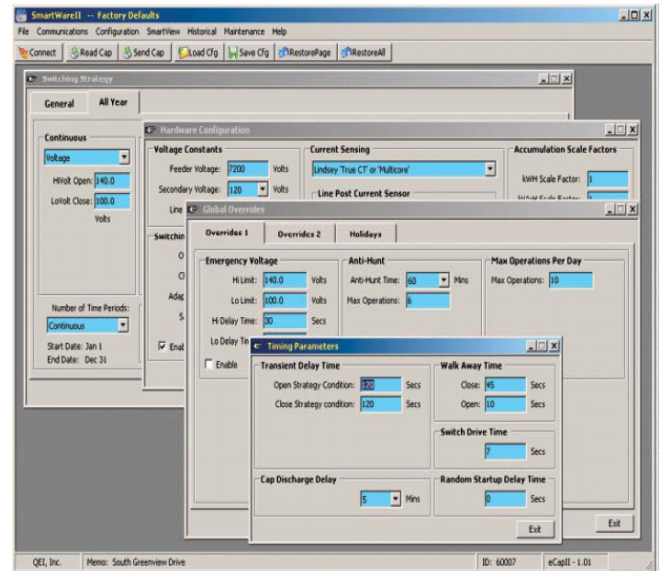

## Strategies

Available bank states and switching strategies are:

- No Operation
- Always Opened
- Always Closed
- Voltage
- Temperature
- Current
- kVAR
- KW
- Power Factor

## Overrides

Both Seasonal & Global overrides can be configured for:

- Reverse Power
- Neutral Current/Voltage
- Max Operations Per Day
- Emergency Voltage
- Day of Week (DOW) Override

## Safety Timers

User adjustable timers include:

- Anti-Hunt
- Capacitor Discharge
- Transient Delays
- Maximum Operations
- Walk Away (when control is operated manually)

## Smart Holidays


Up to 50 holidays can be specified (one time or recurring, fixed or rule-based). The controller can be configured to open or close the bank during a holiday plus a voltage override can be enabled for the holiday.

## Daylight Saving Time

Can be enabled for disabled and the starting and ending DST dates can be specified.



## Setting the Standard for Automation Controls

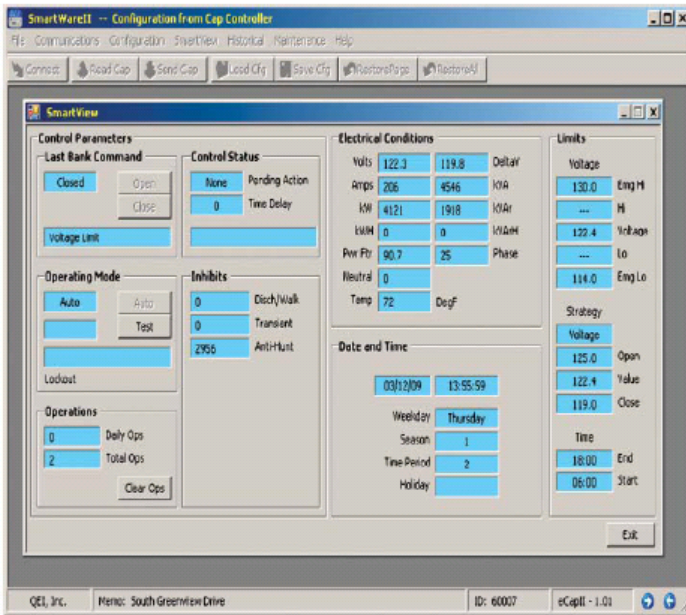


### SmartView Display

SmartView allows the user to view system information and operate the control in the field using a computer. The “Limits” section provides a summary of the current switching strategy settings. A Test Mode is provided for opening or closing the capacitor bank.

### Trend Table

The Trend Table display allows a user to view all collected trend data from the control in a tabular form. The displayed data can be exported to either an Excel file (spreadsheet) or HTML file by selecting the XL export button.

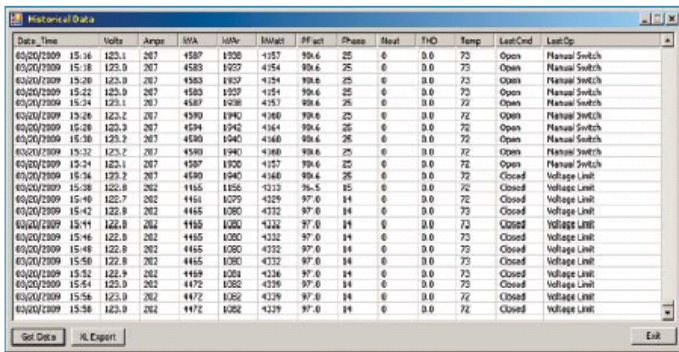

Date/Time	Volts	Amper	kVA	kW	kVAr	Pwr Ftr	Phase	Heat	THD	Temp	LastCmd	LastOp
03/02/2009 15:16	123.1	267	4587	1336	-1157	99.6	25	0	0.0	72	Open	Manual Switch
03/02/2009 15:18	123.9	267	4583	1323	-1154	99.6	25	0	0.0	72	Open	Manual Switch
03/02/2009 15:20	123.9	267	4583	1323	-1154	99.6	25	0	0.0	72	Open	Manual Switch
03/02/2009 15:22	123.9	267	4583	1323	-1154	99.6	25	0	0.0	72	Open	Manual Switch
03/02/2009 15:24	123.1	267	4587	1326	-1157	99.6	25	0	0.0	72	Open	Manual Switch
03/02/2009 15:26	122.2	267	4579	1310	-1140	99.6	25	0	0.0	72	Open	Manual Switch
03/02/2009 15:28	123.9	267	4594	1342	-1164	99.6	25	0	0.0	72	Open	Manual Switch
03/02/2009 15:30	123.2	267	4580	1340	-1160	99.6	25	0	0.0	72	Open	Manual Switch
03/02/2009 15:32	122.2	267	4589	1340	-1160	99.6	25	0	0.0	72	Open	Manual Switch
03/02/2009 15:34	123.1	267	4597	1330	-1157	99.6	25	0	0.0	72	Open	Manual Switch
03/02/2009 15:36	123.2	267	4580	1340	-1160	99.6	25	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:38	122.8	262	4165	1158	-1219	96.5	15	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:40	122.7	262	4161	1279	-1229	97.0	14	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:42	122.8	262	4165	1280	-1232	97.0	14	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:44	122.8	262	4165	1280	-1232	97.0	14	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:46	122.8	262	4165	1280	-1232	97.0	14	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:48	122.8	262	4165	1280	-1232	97.0	14	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:50	122.8	262	4165	1280	-1232	97.0	14	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:52	122.9	262	4169	1284	-1236	97.0	14	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:54	123.0	262	4172	1282	-1239	97.0	14	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:56	122.9	262	4172	1282	-1239	97.0	14	0	0.0	72	Closed	Voltage Limit
03/02/2009 15:58	123.9	262	4172	1282	-1239	97.0	14	0	0.0	72	Closed	Voltage Limit

### SmartTREND™

The trends are displayed as 1-4 strip charts with 1-2 color pens on each chart. Controls are provided to adjust the scale of each pen. Select the pen number; then select the Zoom button and the user can zoom the trace in or out, move the trace up or down, or type in the minimum and/or maximum trace limits. The pen number of each trace is shown with the pen label on the far left or right of the strip chart.




# Specifications

Input Voltage	120 VAC or 240 VAC The supply voltage is also use to sense the line voltage
Line Frequency	50 Hz or 60 Hz
Power consumption End	6-8 VA max
Capacitor Switch Relays	Electro mechanical relays rated at 20 amps continuous duty at 240 VAC
Optional Temperature Sensor Range	-0° to 140°F (-18° to 60°C)
Line Current Sensor Input	Line Post Sensor (LPCS) Max Input = 25.5 Vrms Current Transformer (CT) models: Max Input = 5 Amps (Line Current Sensor not supported for limited models.)
Neutral Detection Sensor Input	Line Post Sensor (LPCS): Max Input = 10 VAC Current Transformer (CT): Max Input = 5 Amps Potential Transformer (PT): Max Input = 150 VAC (Neutral Detection sensor not supported for Limited models.)
Historical Data Storage	The average of all electrical parameters are saved on a 5-minute interval (84 days), or 15 minute interval (252 days) and stored in non-volatile (FLASH) memory.
Front Panel USB Data Port	Used for configuration of controller, display of real-time measurements, and historical data collection. Also allows for firmware upgrade via laptop PC
Language Interface	English standard, Spanish available on request
Enclosure	NEMA 4X rated, weatherproof outdoor type. Non-corrosive high impact polymer. MCAp II: 8"H x 8"W x 4"D eCAP II: 12"H x 10"W x 6"D (Stainless Steel Option Available) MCAp II: 10.38" H x 8" W x 6" D eCAP II 12.13"H x 10"W x 8"D
Weight (Approximate, Depending on Mounting Option)	MCAp II: 5 lbs. (2.3 kg) eCAP II: 9.5 lbs. (4.3 kg)
Environment	Temperature: -40° to 149°F (-40° to 65°C) Humidity: 95% (non-condensing)
Radio/Modem Power Supply (eCAP II)	2.5 Amp, 12 VDC power supply and isolated RS 232 connection
Mounting Configuration	Meter Socket or surface Mount
Upgrades	Firmware upgrades via front panel USB port
Standard Protocols (eCAP II)	DNP 3.0, Modbus, QUICS, others available upon request


# Automatic Capacitor Controllers



CONFIGURATION OPTIONS		QC					
<b>CONTROL TYPE</b>							
M	MCap II						
E	ECap II						
<b>FUNCTIONALITY (Note 1)</b>							
1	Standard						
2	Extended (LCD Display & Configuration Switches)						
3	Limited Standard (Time, Temp, Voltage only)						
4	Limited Extended (TTV, LCD Display & Configuration Switches)						
<b>CONTROL OPERATING VOLTAGE &amp; FREQUENCY</b>							
1	120 VAC/60 Hz						
2	120 VAC/50 Hz						
3	240 VAC/60 Hz						
4	240 VAC/50 Hz						
<b>MOUNTING/BASE CONFIGURATION (Note 2)</b>							
A	Meter Base 'A' Configuration						
C	Meter Base 'C' Configuration						
D	Meter Base 'D' Configuration						
E	Meter Base 'E' Configuration						
F	Meter Base 'F' Configuration						
G	Meter Base 'G' Configuration						
H	Meter Base 'H' Configuration						
J	Meter Base 'J' Configuration						
K	Meter Base 'K' Configuration						
P	Cable (7-Pin Circular Connector), for Surface Mount						
T	Terminal Strip, for Surface Mount						
<b>PHASE CURRENT INPUT (Note 1 &amp; 3)</b>							
1	0-25VAC INPUT (Line Post Sensor) (Default for Limited Models)						
2	0-5 AMP INPUT (CT)						
<b>NEUTRAL DETECTION INPUT (Note 1 &amp; 3)</b>							
1	None (Default for Limited Models)						
2	0-5 AMP INPUT (Neutral Current CT)						
3	0-150VAC INPUT (Neutral Voltage PT)						
4	0-10VAC INPUT (Neutral Voltage LPS)						
<b>TEMPERATURE SENSING OPTION</b>							
N	No Temperature Sensor						
T	Temperature Sensor						

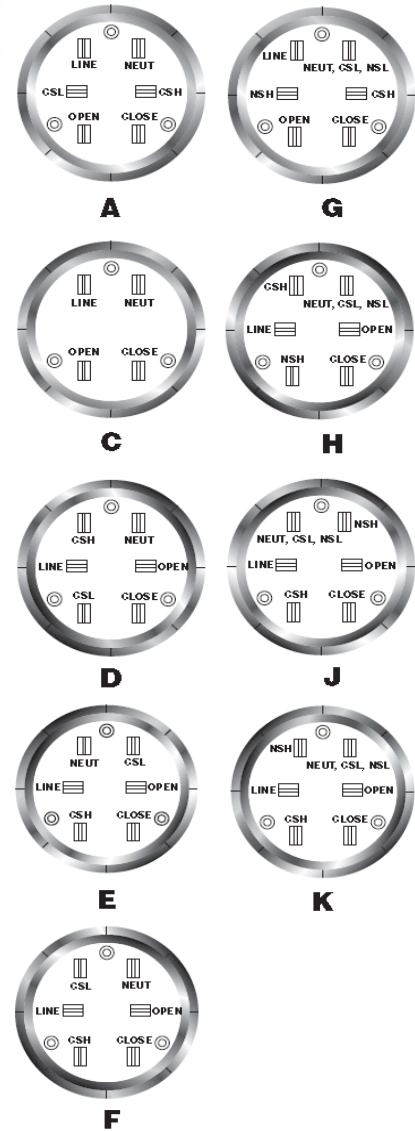


Control Cables		QEC		
<b>Cable Connector Type</b>				
A	Circular Style Connector (female) at controller end, no connector at other end			
B	No Connector at Either End (for Terminal Strip Connections)			
C	Circular Style Connector on each end (for connection to junction box)			
<b>Length of Cable in Feet</b>				
Maximum length = 45 feet (15m)				
(Standard Control Cable is 6 Conductor 16 AWG neoprene cable)				



**Circular style Connector Pin-Out for Pole-Mounted Capacitors (As viewed from enclosure exterior)**

- A Line
- B Open
- C Close
- D Not Used
- E NSH
- F CSH
- G Neutral, CSL, NSL
- Black
- Green
- Red
- Blue
- Orange
- White

## Terminal Strip Wiring

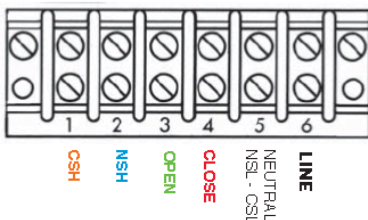

CSH = Line Current Signal High  
 CSL = Line Current Signal Low  
 NSH = Neutral Current Signal High  
 NSL = Neutral Current Signal Low

- **SCADA Systems · Control Centers · Multifunction Gateways ·**
- **Remote Terminal Units · Substation Automation ·**
- **Distribution Automation · Feeder Automation ·**
- **Capacitor Controllers ·**

For a half century, QEI has been providing the utility industry with the finest products available. With our extensive experience and deep appreciation of the needs of our clients and customers, we have been the leaders in innovation.

Whatever your requirements for application, contact us for a custom solution



**QEI, LLC**  
45 Fadem Road  
Springfield, NJ 07081 USA  
T: +973-379-7400 F: +973-379-2138  
E: [sales@qeinc.com](mailto:sales@qeinc.com)  
W: [www.qeinc.com](http://www.qeinc.com)

This literature is for illustration purposes only, and is not part of any contract. As we have a policy of continuous product improvement, any features may be modified without notice. All trademarks and names mentioned in this document remain the exclusive property of their holder.

V1.3 4/19

